

CENTRO DI RICERCA E SPERIMENTAZIONE  
PER L'INDUSTRIA CERAMICA

Requested by:	GLASSFER S.r.l. Via S.Maurizio, 66 22036 ERBA (CO)	
For the sample:	Glass slab 50 x 100 x 0.40 cm, marked "DOT XL".	
On (date): 08/02/2021	Date of receipt in laboratory (sample delivered by the client):	03/03/2021
Sampling details	By whom: CUSTOMER	
- Where: -----		
- Date: -----		
- How (methods): -----		
Tested in: Sassuolo	Date of starting: 04/03/2021	Date of ending: 04/03/2021

**DIN 51130:2004**

**Determination of the anti – slip properties - Workrooms and fields of activities with raised slip danger, walking method - ramp test**

Surface characteristics       Smooth       Profiled       Structured       Rough

**OPERATIVE CONDITIONS:**

Temperature:      (23 ± 5) °C  
Fixing scheme


See attachment

**RESULTS**

Average total acceptance angle:      **11,8°**  
Movement area (cm<sup>3</sup>/dm<sup>2</sup>):      Not tested

**CLASSIFICATION (DGUV REGEL 108-003)**

Group of anti – slip properties:      **R10**  
Movement area evaluation group:      Not tested


Pietro Bruzzi  
Technical verification  




Prof.ssa Maria Chiara Bignozzi  
Director  


----- End of report -----

The results reported relate only to the samples tested. No responsibility is taken for the accuracy of the sampling unless it is done under our own supervision. The reproduction of this test report is only authorized in the form of a complete photographic facsimile. Our written approval is necessary for any partial reproduction. The texts in inverted commas are Customer's declarations and fall under his responsibility. This test report consists of 1 page and 1 attachment.

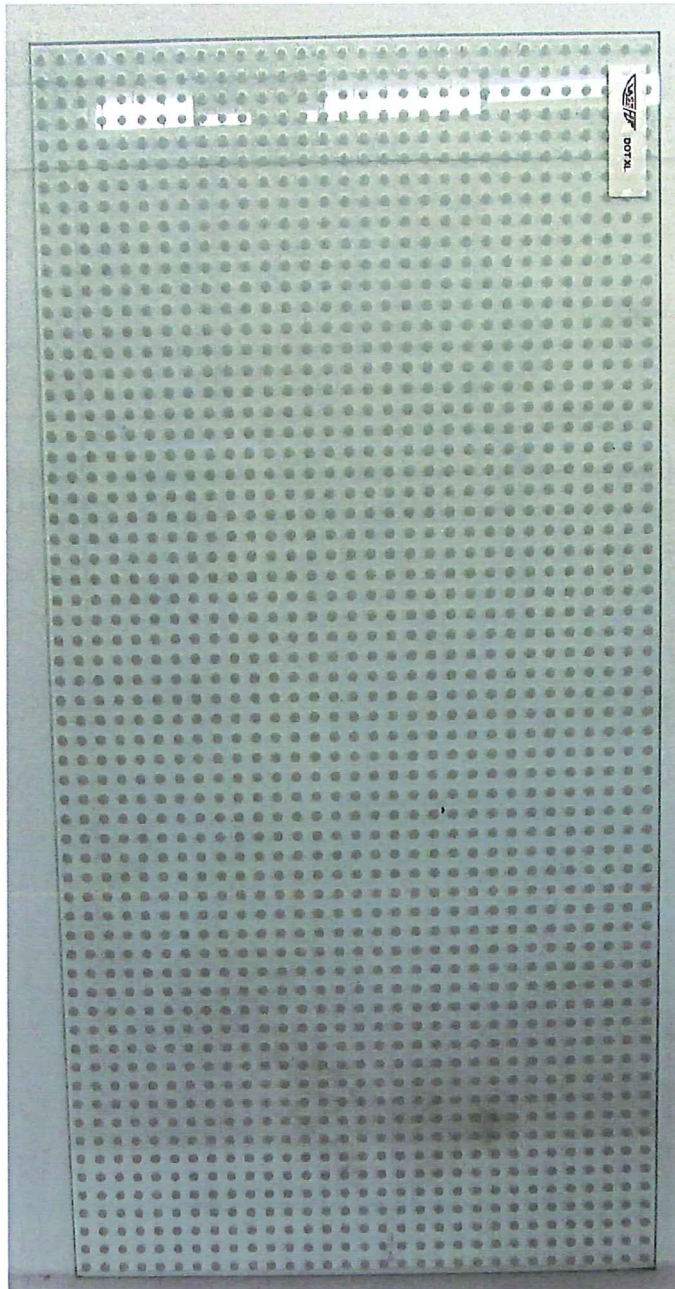

walking  
direction