

CENTRO DI RICERCA E SPERIMENTAZIONE
PER L'INDUSTRIA CERAMICA

Requested by:	GLASSFER S.r.l. Via S.Maurizio, 66 22036 ERBA (CO)	
For the sample:	Glass slab 50 x 100 x 0.40 cm, marked "DOT".	
On (date): 08/02/2021	Date of receipt in laboratory (sample delivered by the client):	03/03/2021
Sampling details	By whom: CUSTOMER	
- Where: -----		
- Date: -----		
- How (methods): -----		
Tested in: Sassuolo	Date of starting: 04/03/2021	Date of ending: 04/03/2021

DIN 51130:2004

Determination of the anti – slip properties - Workrooms and fields of activities with raised slip danger, walking method - ramp test

Surface characteristics Smooth Profiled Structured Rough

OPERATIVE CONDITIONS:

Temperature: (23 ± 5) °C
Fixing scheme

See attachment

RESULTS

Average total acceptance angle: 17,3°
Movement area (cm³/dm²): Not tested

CLASSIFICATION (DGUV REGEL 108-003)

Group of anti – slip properties: **R10**
Movement area evaluation group: Not tested

Pietro Bruzzi
Technical verification




Prof.ssa Maria Chiara Bignozzi
Director

----- End of report -----

The results reported relate only to the samples tested. No responsibility is taken for the accuracy of the sampling unless it is done under our own supervision. The reproduction of this test report is only authorized in the form of a complete photographic facsimile. Our written approval is necessary for any partial reproduction. The texts in inverted commas are Customer's declarations and fall under his responsibility. This test report consists of 1 page and 1 attachment.

CENTRO DI RICERCA E SPERIMENTAZIONE
PER L'INDUSTRIA CERAMICA

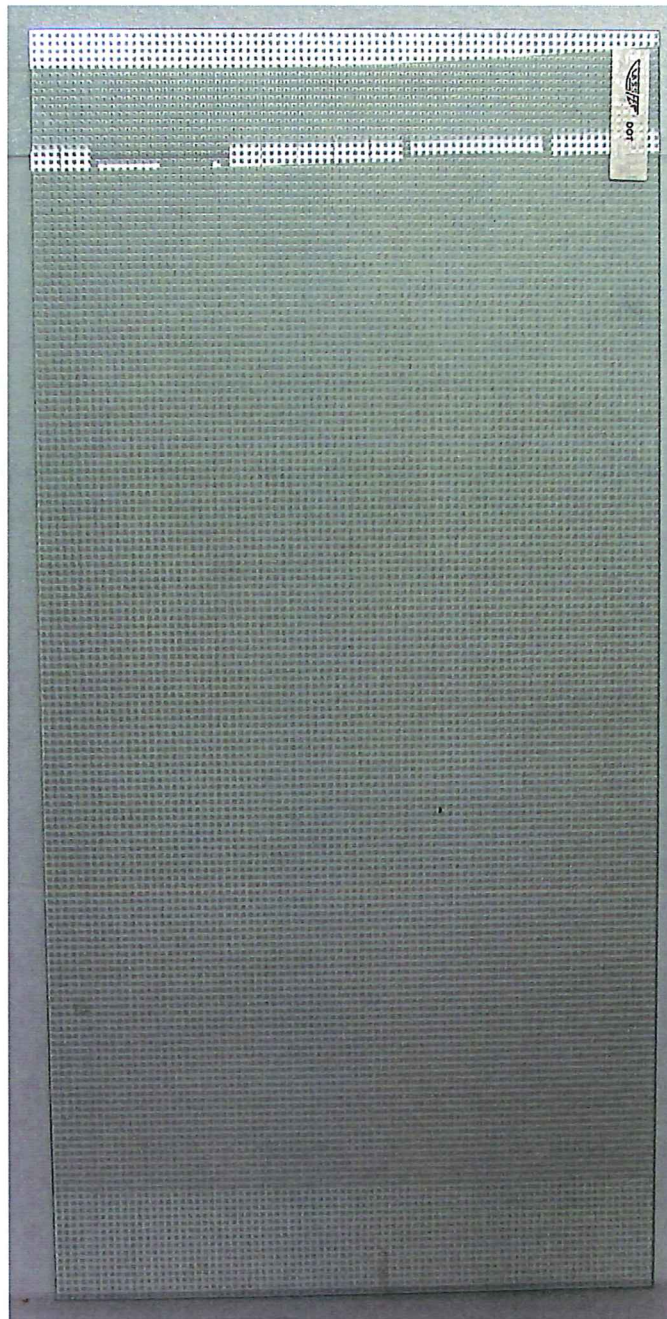

walking
direction